








ARIES CORNER HEATER- Installation Diagram for Separate Control (NS)

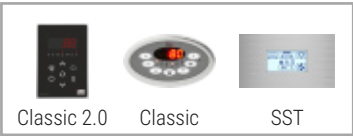

NOTE!
Do not place the sensors too near to air ventilation (not under 1000mm) or not under 500mm from air ventilation, which is directed away from sensors.

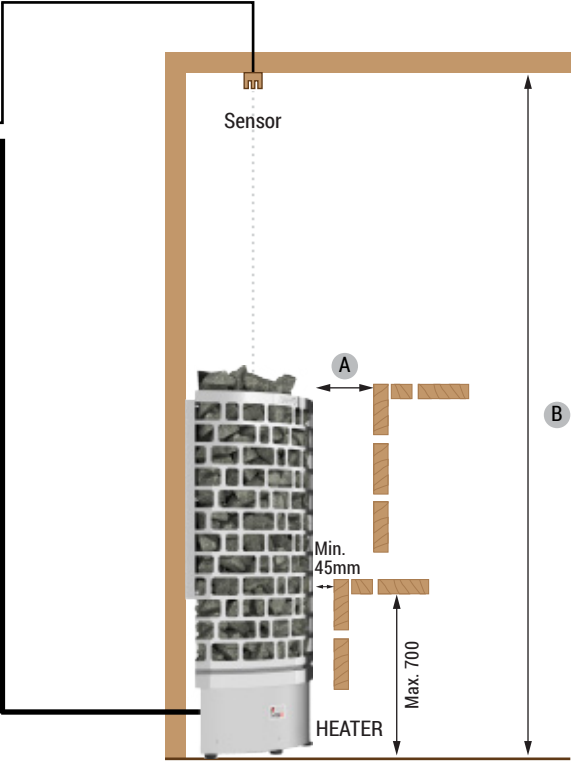

FRONT VIEW

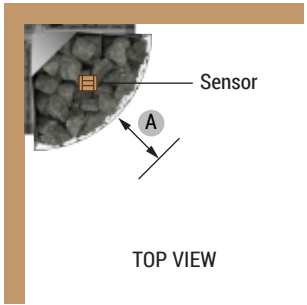


TOP VIEW

Minimum Safety Distances

Heater Model	A	B
ARI3-45NS-WL	100	1900
ARI3-60NS-WL	100	1900
ARI3-75NS-WL	100	1900
ARI3-90NS-WL	100	1900




ARIES CORNER HEATER- Installation Diagram for Saunova 2.0 Control (Ni2)

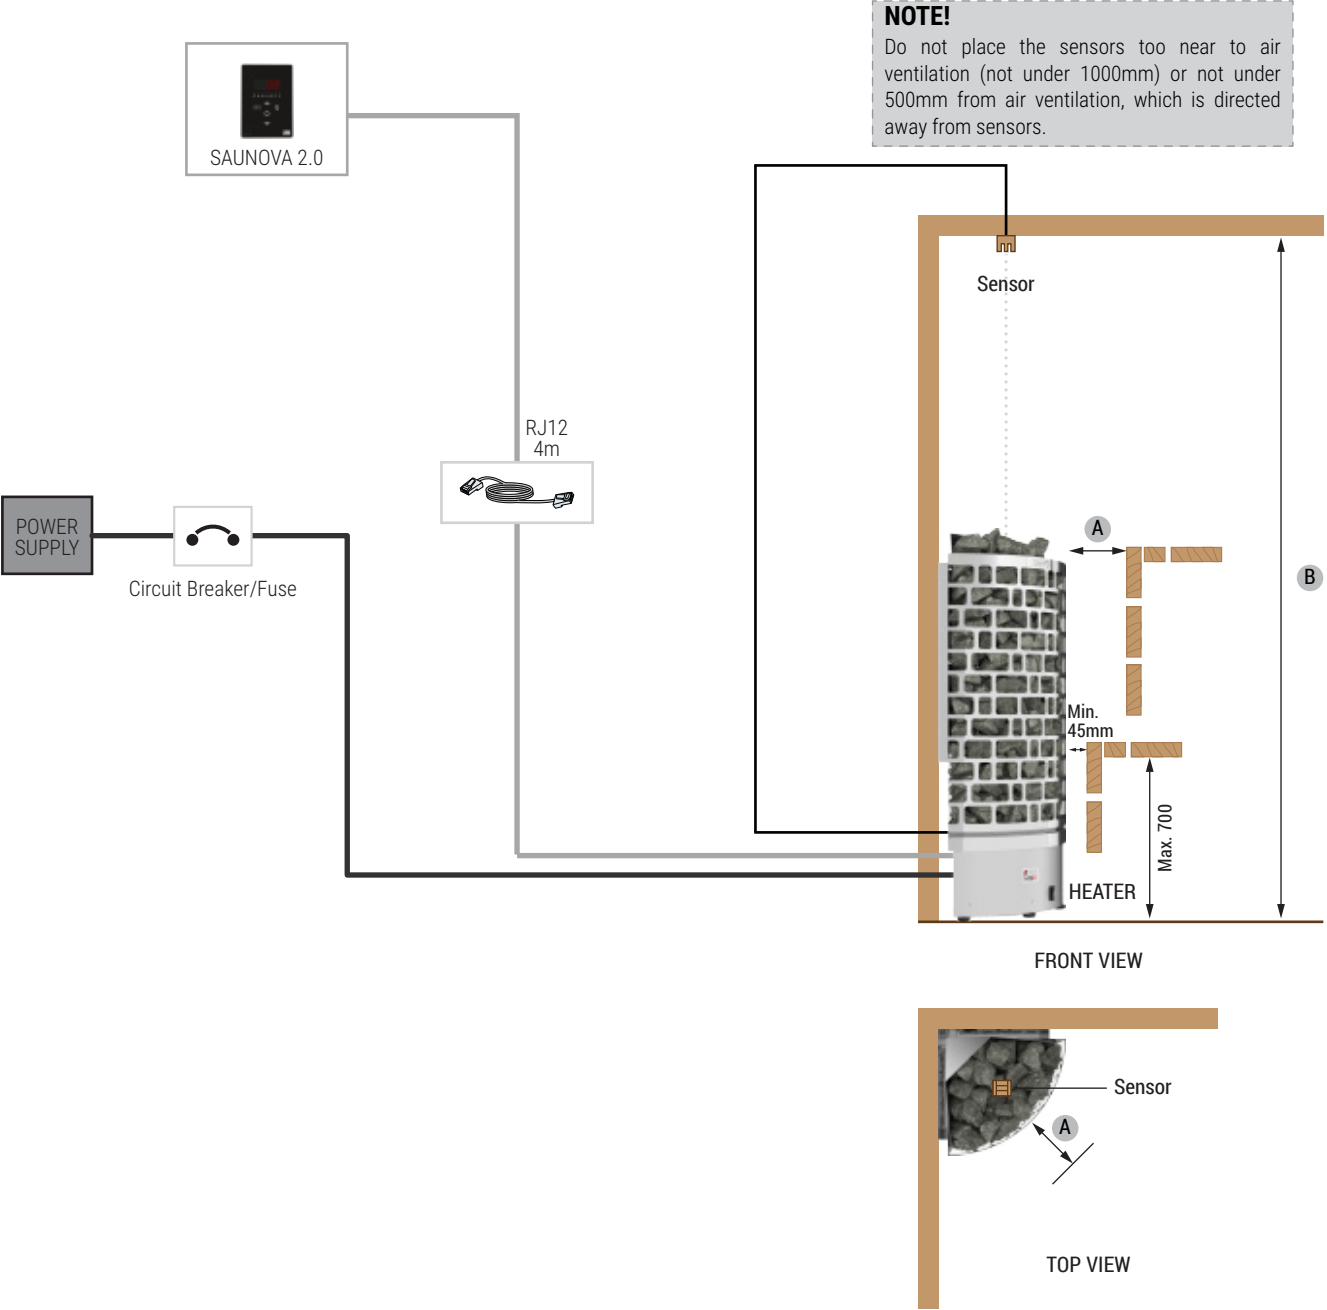

Minimum Safety Distances

Heater Model	A	B
ARI3-45Ni2-WL	100	1900
ARI3-60Ni2-WL	100	1900
ARI3-75Ni2-WL	100	1900
ARI3-90Ni2-WL	100	1900

ARIES CORNER HEATER-
 Installation Diagram for Built-in Control (NB)

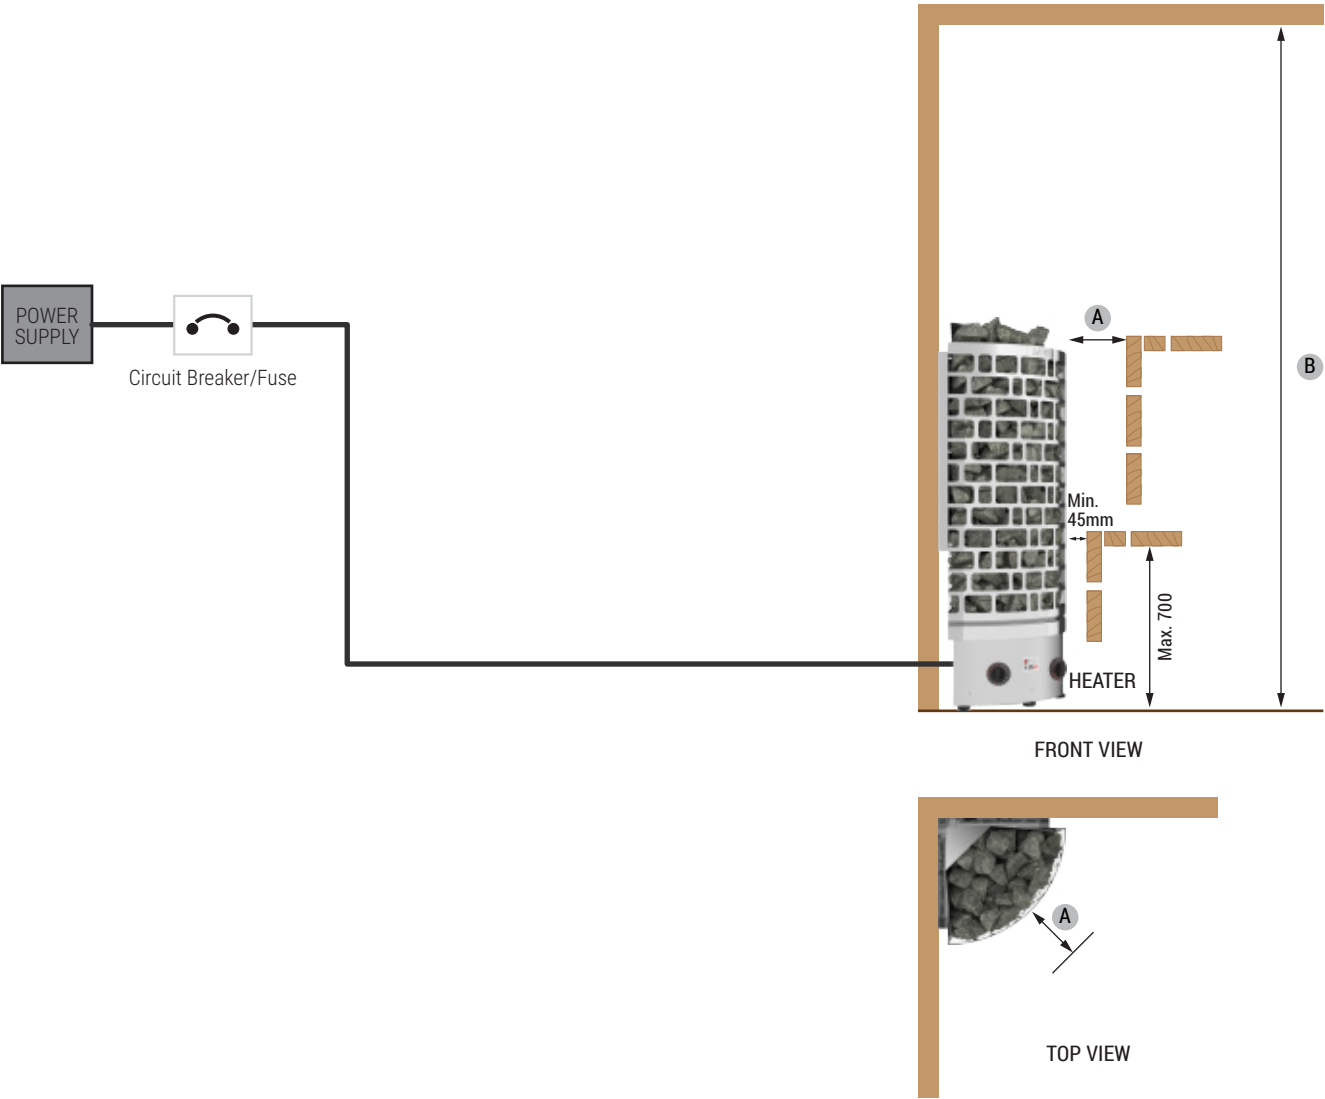

Minimum Safety Distances

Heater Model	A	B
ARI3-45NB-WL	100	1900
ARI3-60NB-WL	100	1900
ARI3-75NB-WL	100	1900
ARI3-90NB-WL	100	1900