


## ARIES CORNER HEATER- Installation Diagram for Separate Control (NS)



### Minimum Safety Distances

	A	B
ARI3-45NS-CNR	100	1900
ARI3-60NS-CNR	100	1900
ARI3-75NS-CNR	100	1900
ARI3-90NS-CNR	100	1900

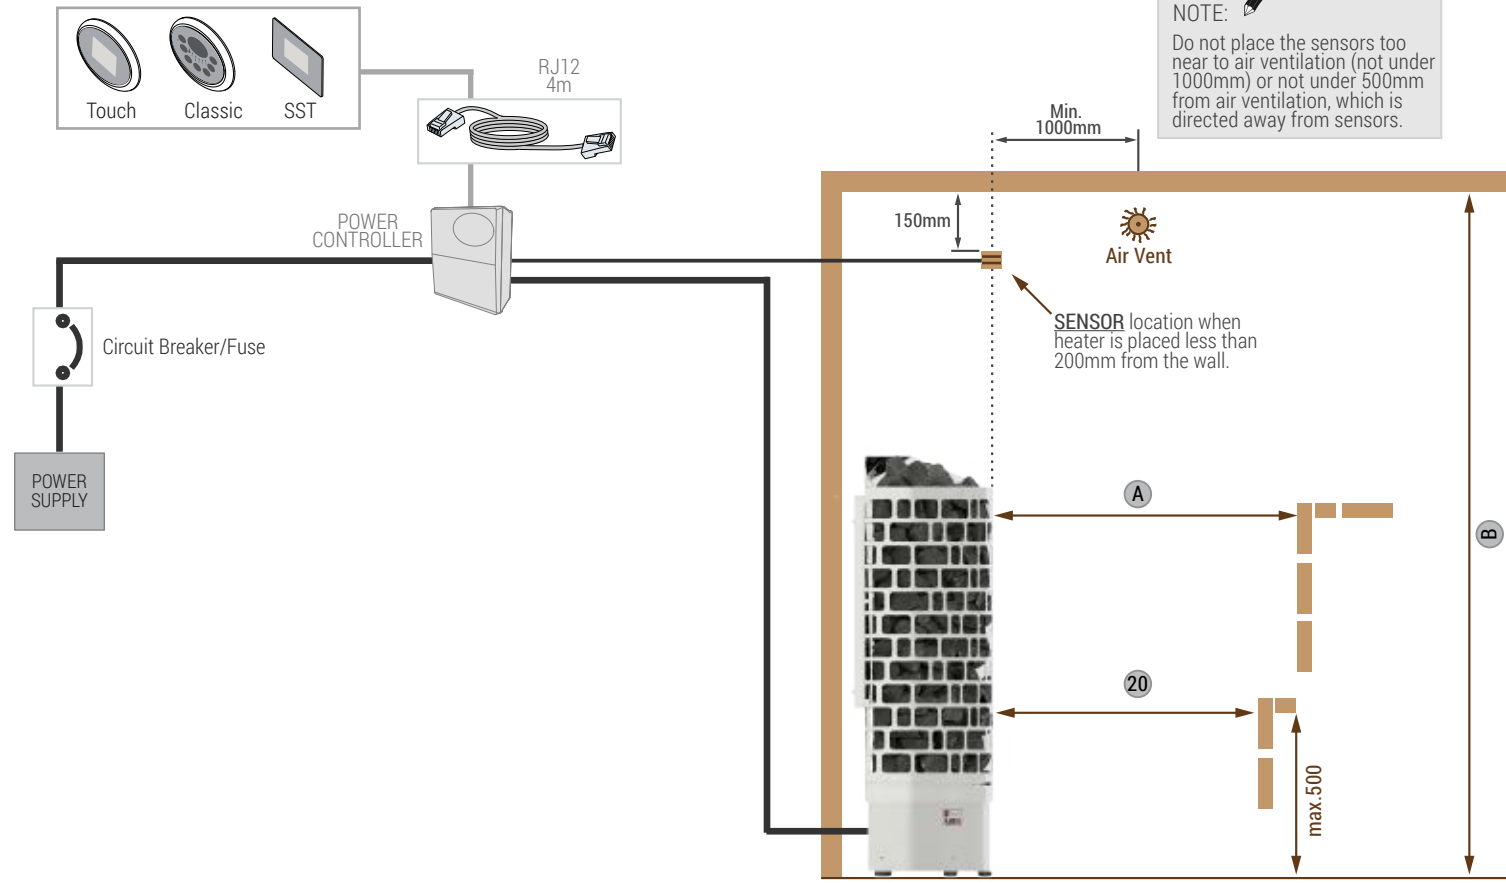

## ARIES CORNER HEATER- Installation Diagram for Built Control (NB)

### Minimum Safety Distances

	A	B
ARI3-45NB-CNR	100	1900
ARI3-60NB-CNR	100	1900
ARI3-75NB-CNR	100	1900
ARI3-90NB-CNR	100	1900

